


NOTES:

1. THE LEVELING PAD SHALL BE CONSTRUCTED OF DGA OR CLEAN #57 STONE MEETING THE FOLLOWING GRADATION:

<u>SIEVE SIZE:</u>	<u>% PASSING:</u>
1"	100 - 95
1/2"	100 - 25
No.4	0 - 10
No.8	0 - 5

2. THE BASE FOUNDATION SHALL BE APPROVED BY THE SITE GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF THE LEVELING PAD.
3. ALL BASE BLOCKS SHALL BE TERRACE WALL STRETCHER UNITS.

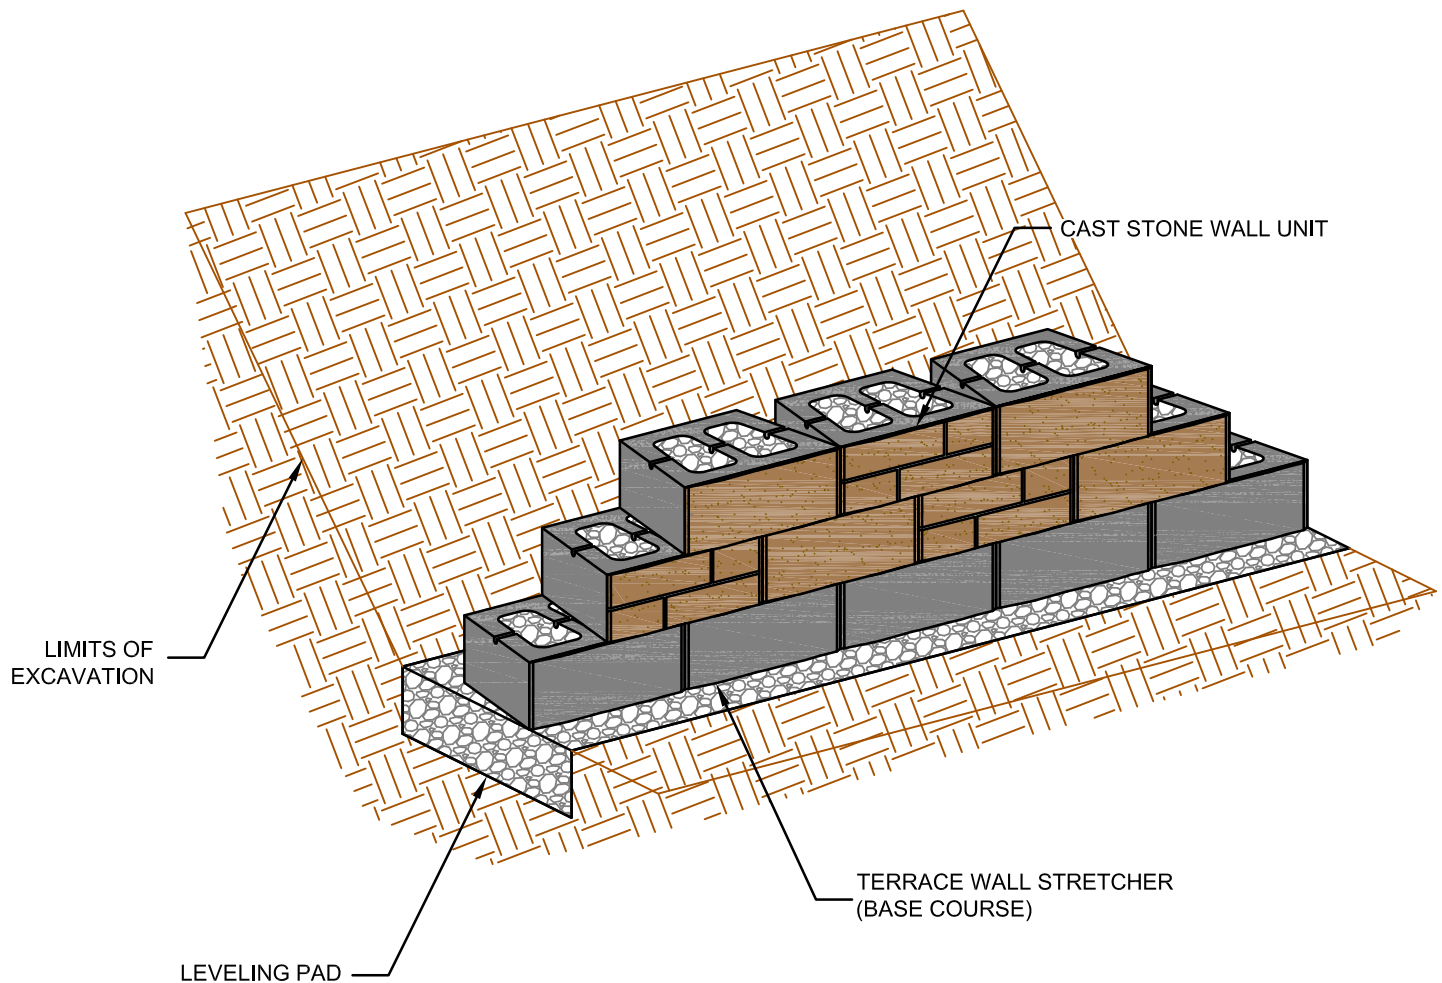

201 Park Ave.
Woodbury, NJ 08096
(800)-444-3679
www.ephenry.com

TITLE: CAST STONE WALL
BASE LEVELING PAD ISOMETRIC

SCALE: NOT TO SCALE