


NOTES:

1. FOUNDATION SOILS SHALL BE PREPARED PER THE GEOTECHNICAL ENGINEERS RECOMMENDATIONS PRIOR TO CONSTRUCTION.
2. OUTLET 4" MINIMUM DRAIN PIPE THROUGH THE WALL FACE OR INTO ONSITE DRAINAGE.
3. BACKFILL 12" BEHIND MARQUIS WALL WITH #57 CLEAN STONE MEETING THE FOLLOWING GRADATION:

SIEVE SIZE: % PASSING:

1"	100 - 95
1/2"	100 - 25
No.4	0 - 10
No.8	0 - 5

4. ALL BASE UNITS SHALL BE MARQUIS STRETCHER UNITS AND SHALL HAVE A MINIMUM EMBEDMENT DEPTH OF 6".

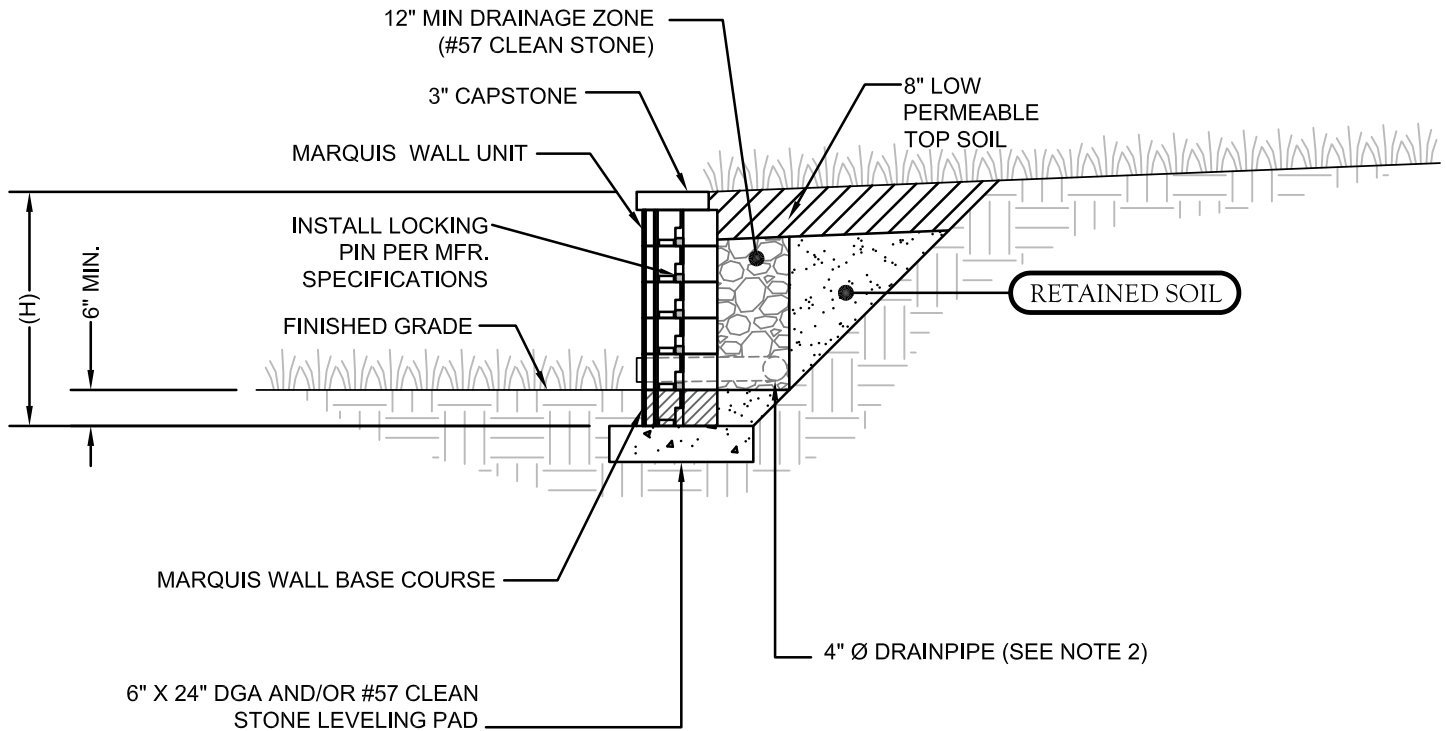

TYPICAL GRAVITY WALL SECTION



201 Park Ave.
Woodbury, NJ 08096
(800)-444-3679
www.ephenny.com

TITLE: MARQUIS WALL
TYPICAL GRAVITY WALL SECTION DETAIL

SCALE: NOT TO SCALE