


NOTES:

1. FOUNDATION SOILS SHALL BE PREPARED PER THE GEOTECHNICAL ENGINEERS RECOMMENDATIONS PRIOR TO CONSTRUCTION.
2. OUTLET 4" MINIMUM DRAIN PIPE THROUGH THE WALL FACE OR INTO ONSITE DRAINAGE.
3. CAST STONE WALL UNIT COREFILL AND 12" DRAINAGE ZONE SHALL BE FILLED WITH #57 CLEAN STONE MEETING THE FOLLOWING GRADATION:

SIEVE SIZE: % PASSING:

1"	100 - 95
1/2"	100 - 25
No.4	0 - 10
No.8	0 - 5

4. ALL BASE UNITS SHALL BE TERRACE STRETCHER UNITS AND SHALL HAVE A MINIMUM EMBEDMENT DEPTH OF 6".
5. HIGH STRENGTH CONCRETE ADHESIVE SHALL BE USED BETWEEN UNITS ON EACH SUCCESSIVE COURSE BEGINNING AT THE TOP OF THE BASE UNITS.
6. **CONSULT WITH LOCAL CODE OFFICIAL FOR WALLS GREATER THAN 4 FEET OR WALLS WITH SURCHARGES.**

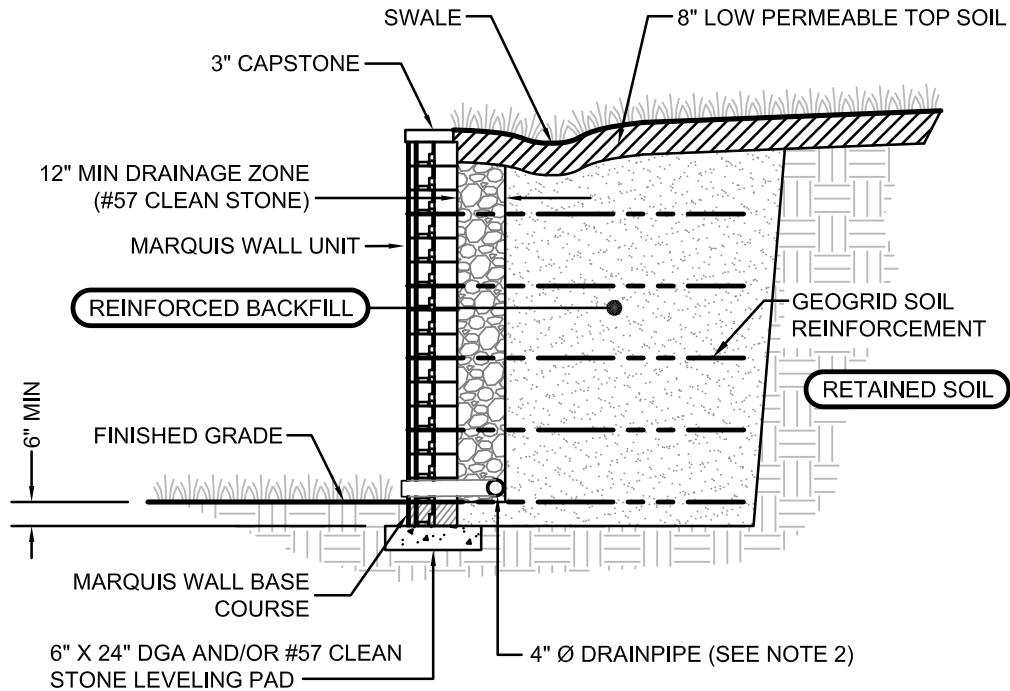

TYPICAL REINFORCED WALL SECTION



201 Park Ave.
Woodbury, NJ 08096
(800)-444-3679
www.ephenry.com

TITLE: MARQUIS WALL
TYPICAL REINFORCED WALL SECTION DETAIL

SCALE: NOT TO SCALE